




a) At the beginning of the process - 0.5 g/l KOH

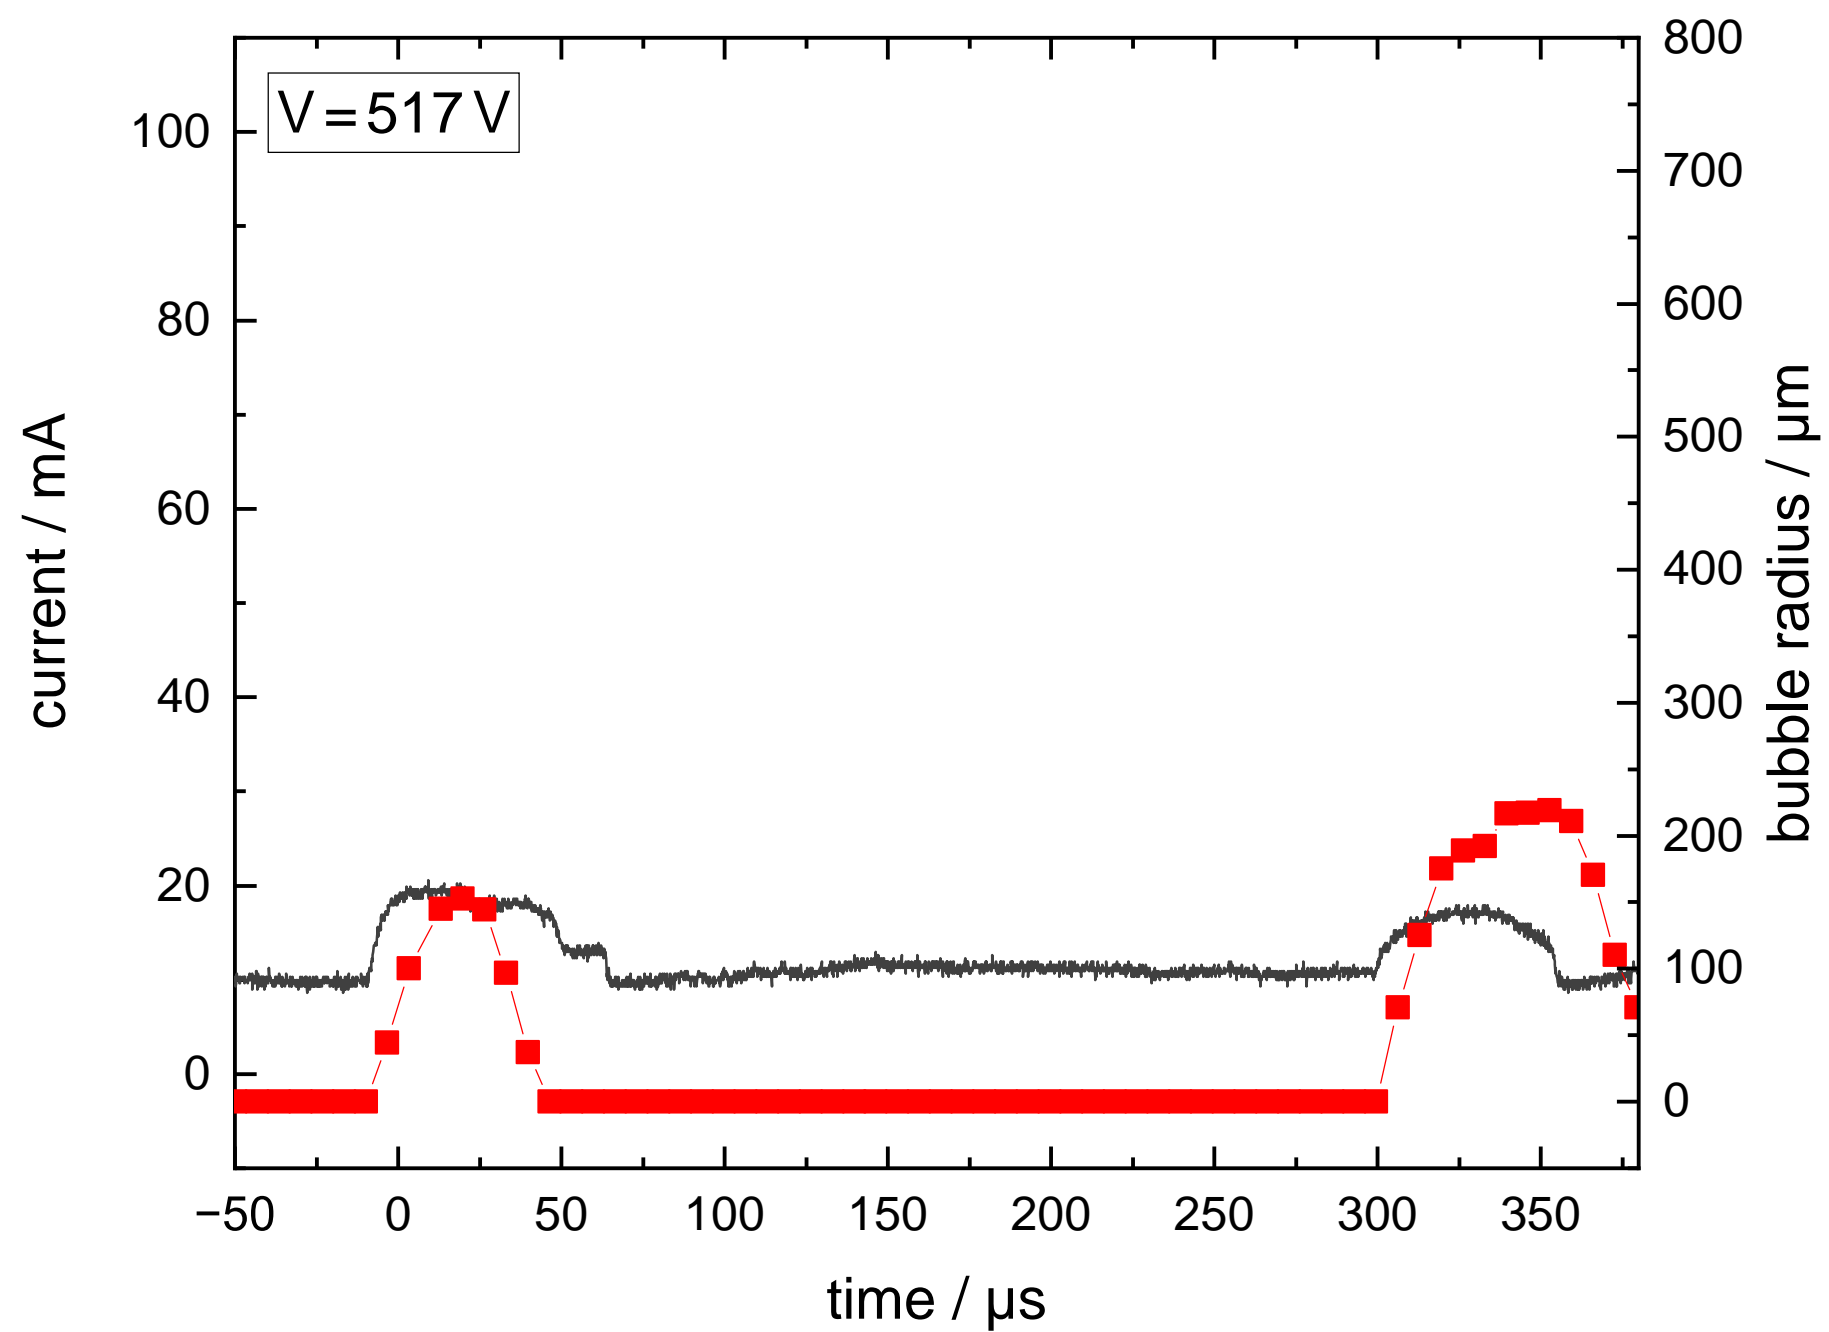

b) After 10 min treatment time - 0.5 g/l KOH

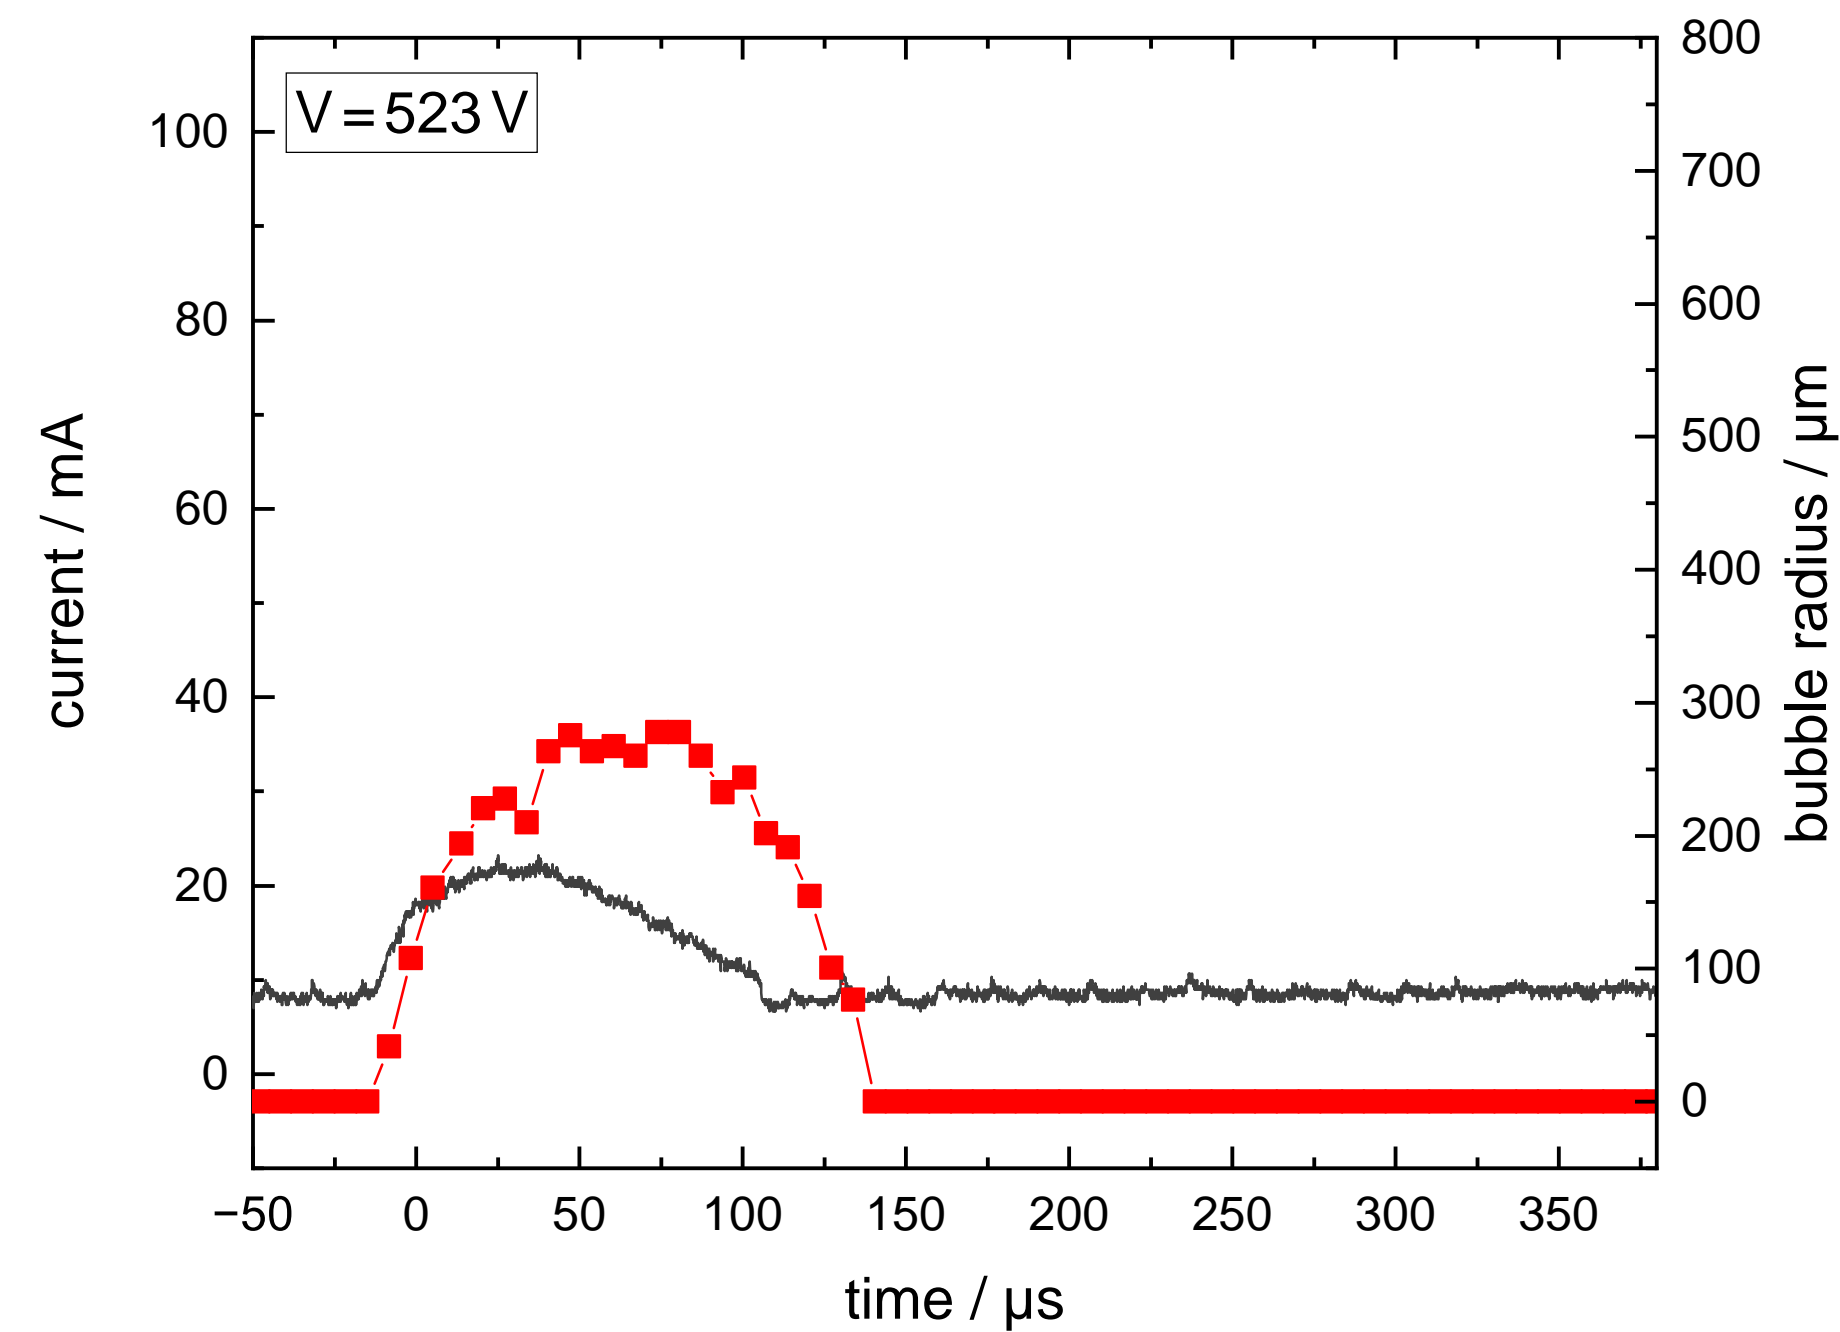

c) At the beginning of the process - 1 g/l KOH

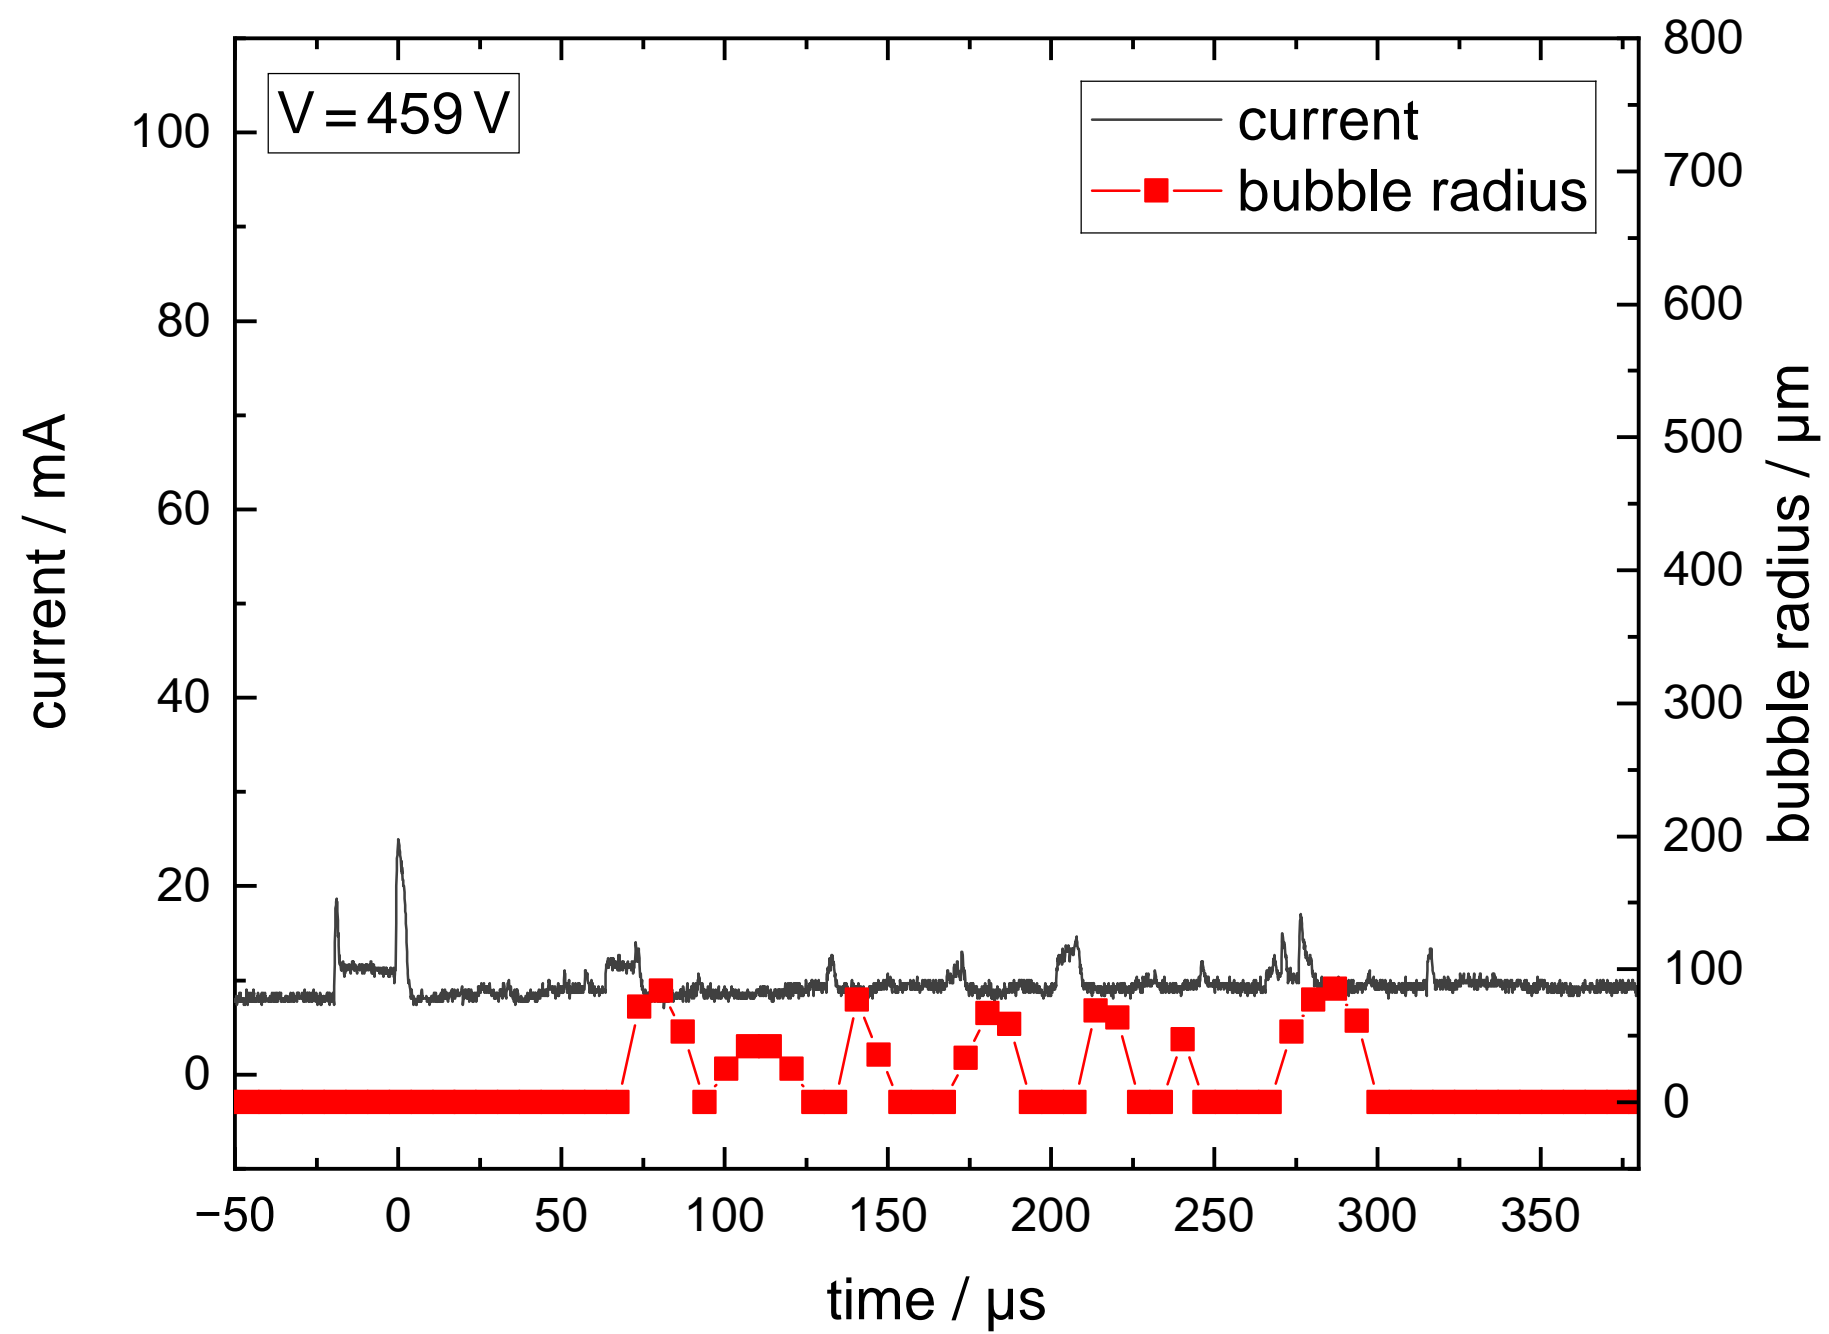

d) After 10 min treatment time - 1 g/l KOH

