




a) At the beginning of the process - 2 g/l KOH

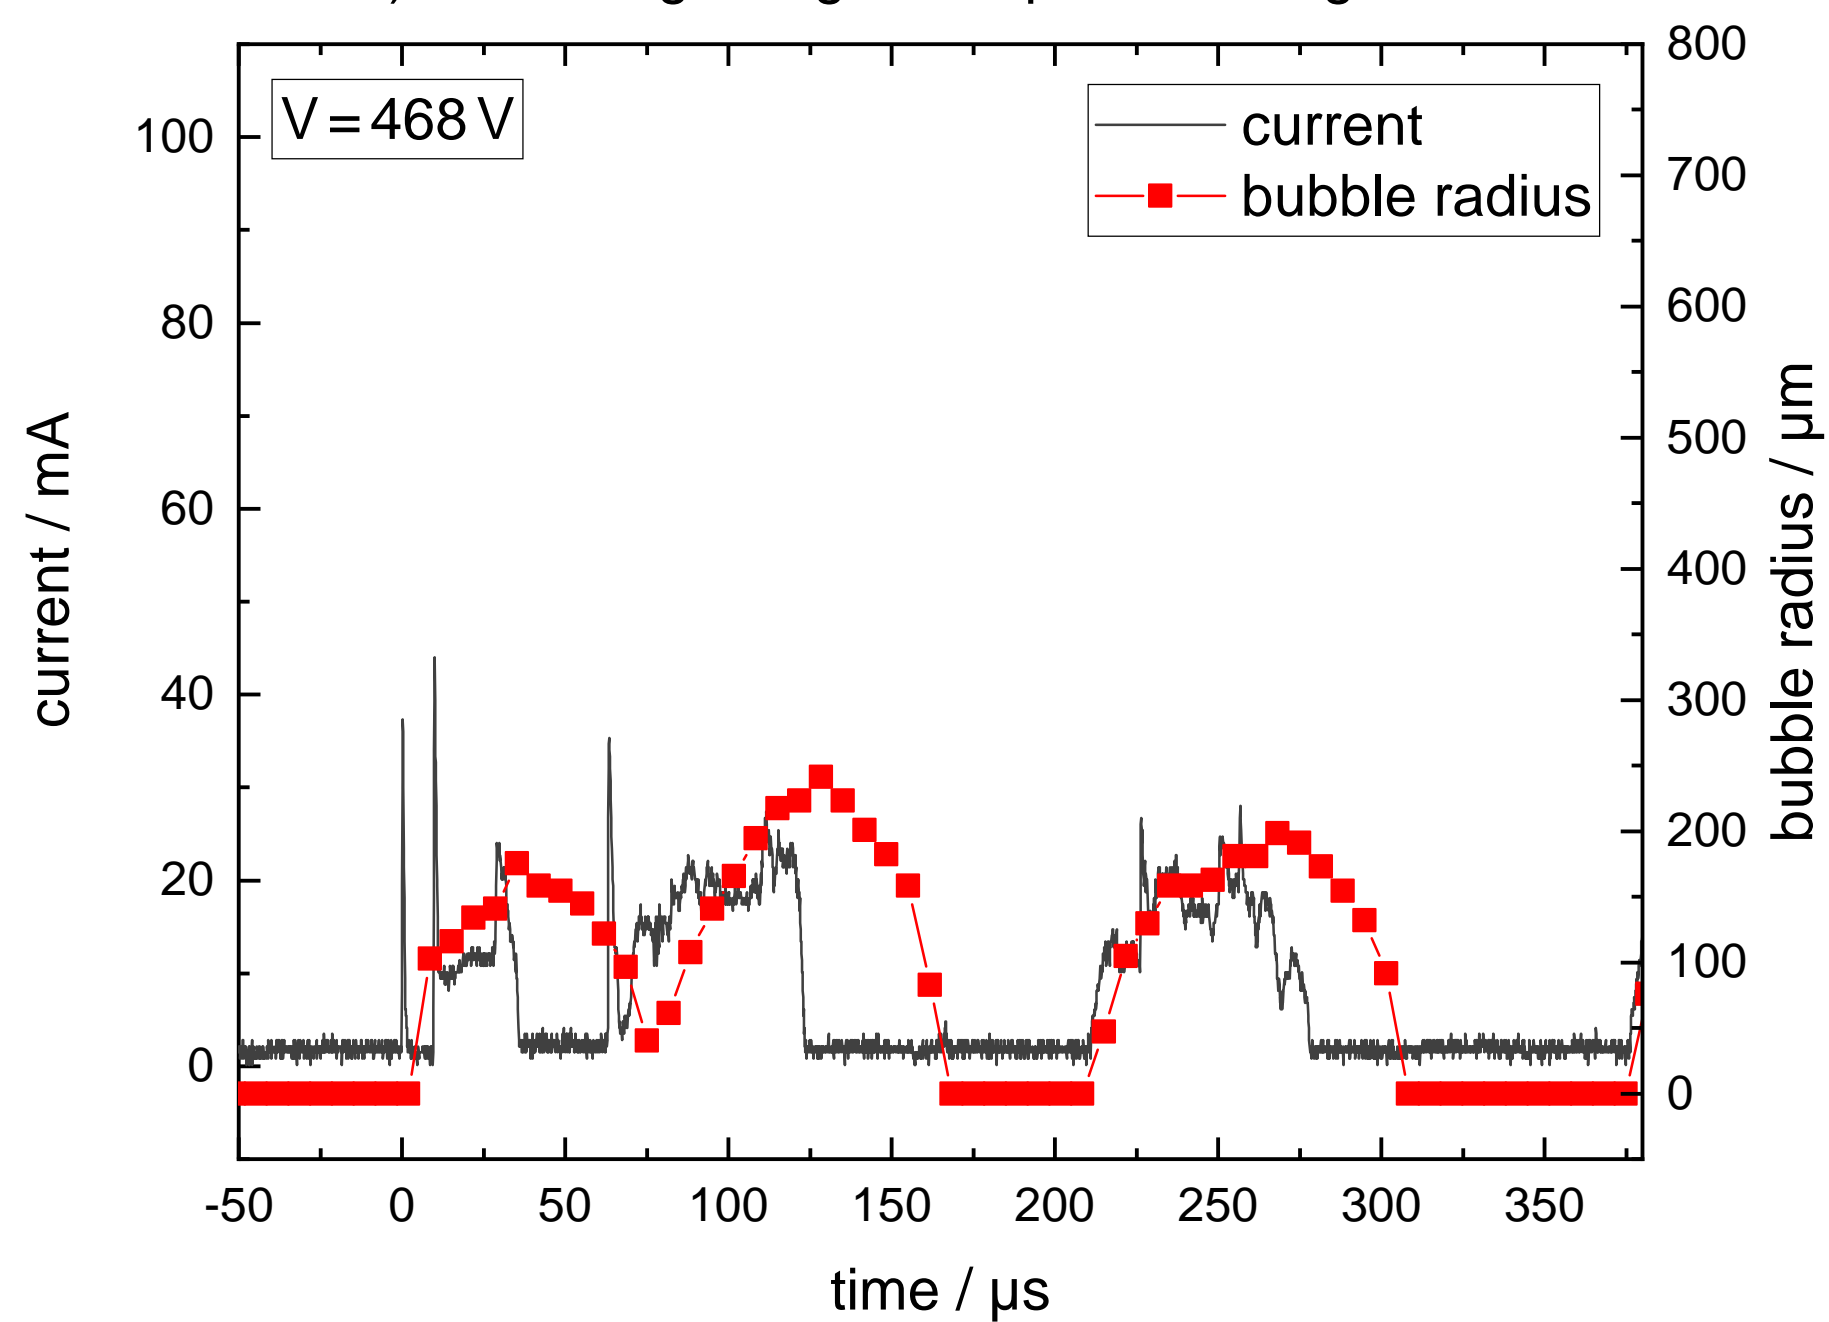


b) After 10 min treatment time - 2 g/l KOH

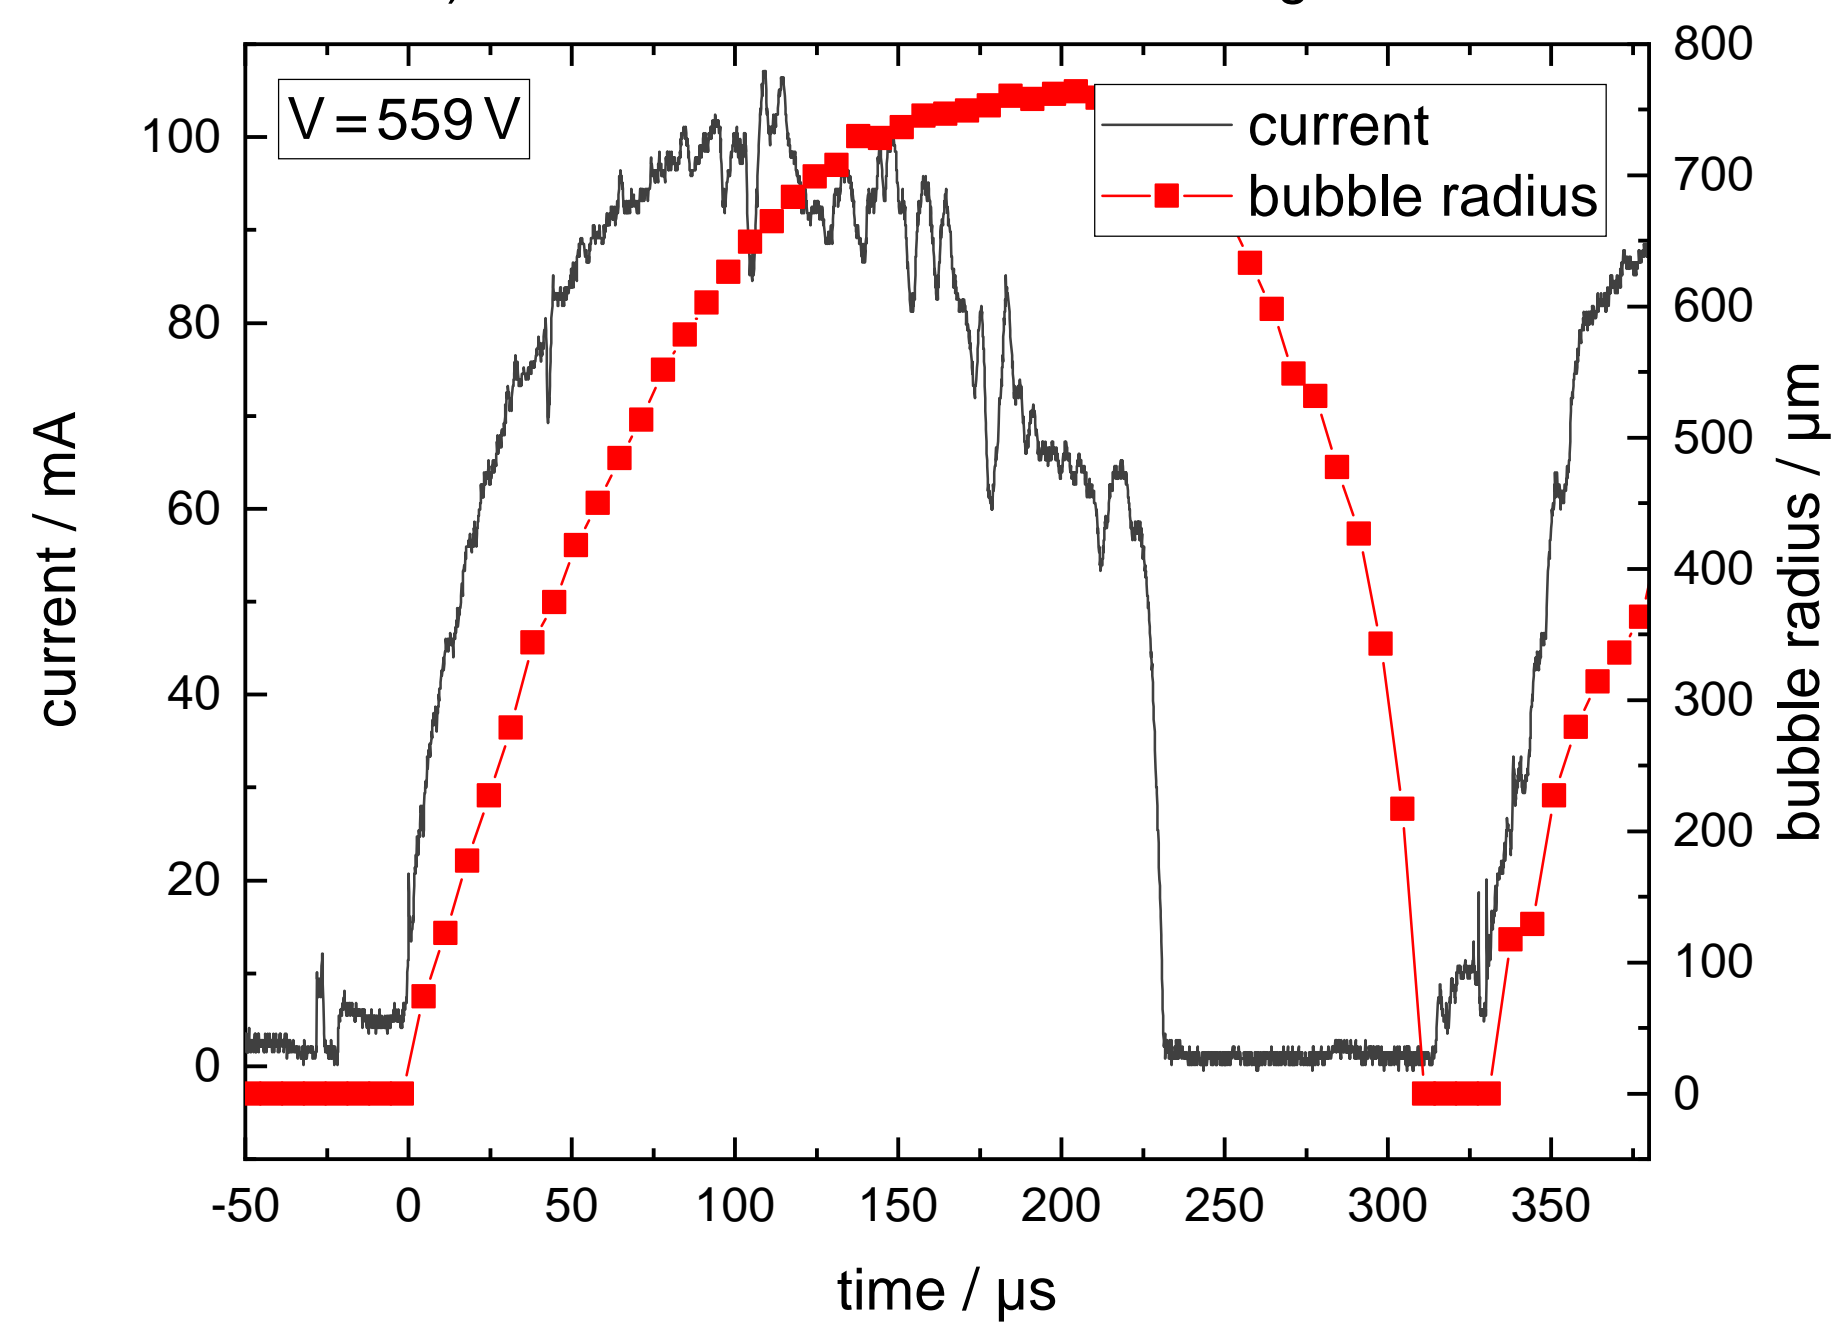


c) At the beginning of the process - 3 g/l KOH

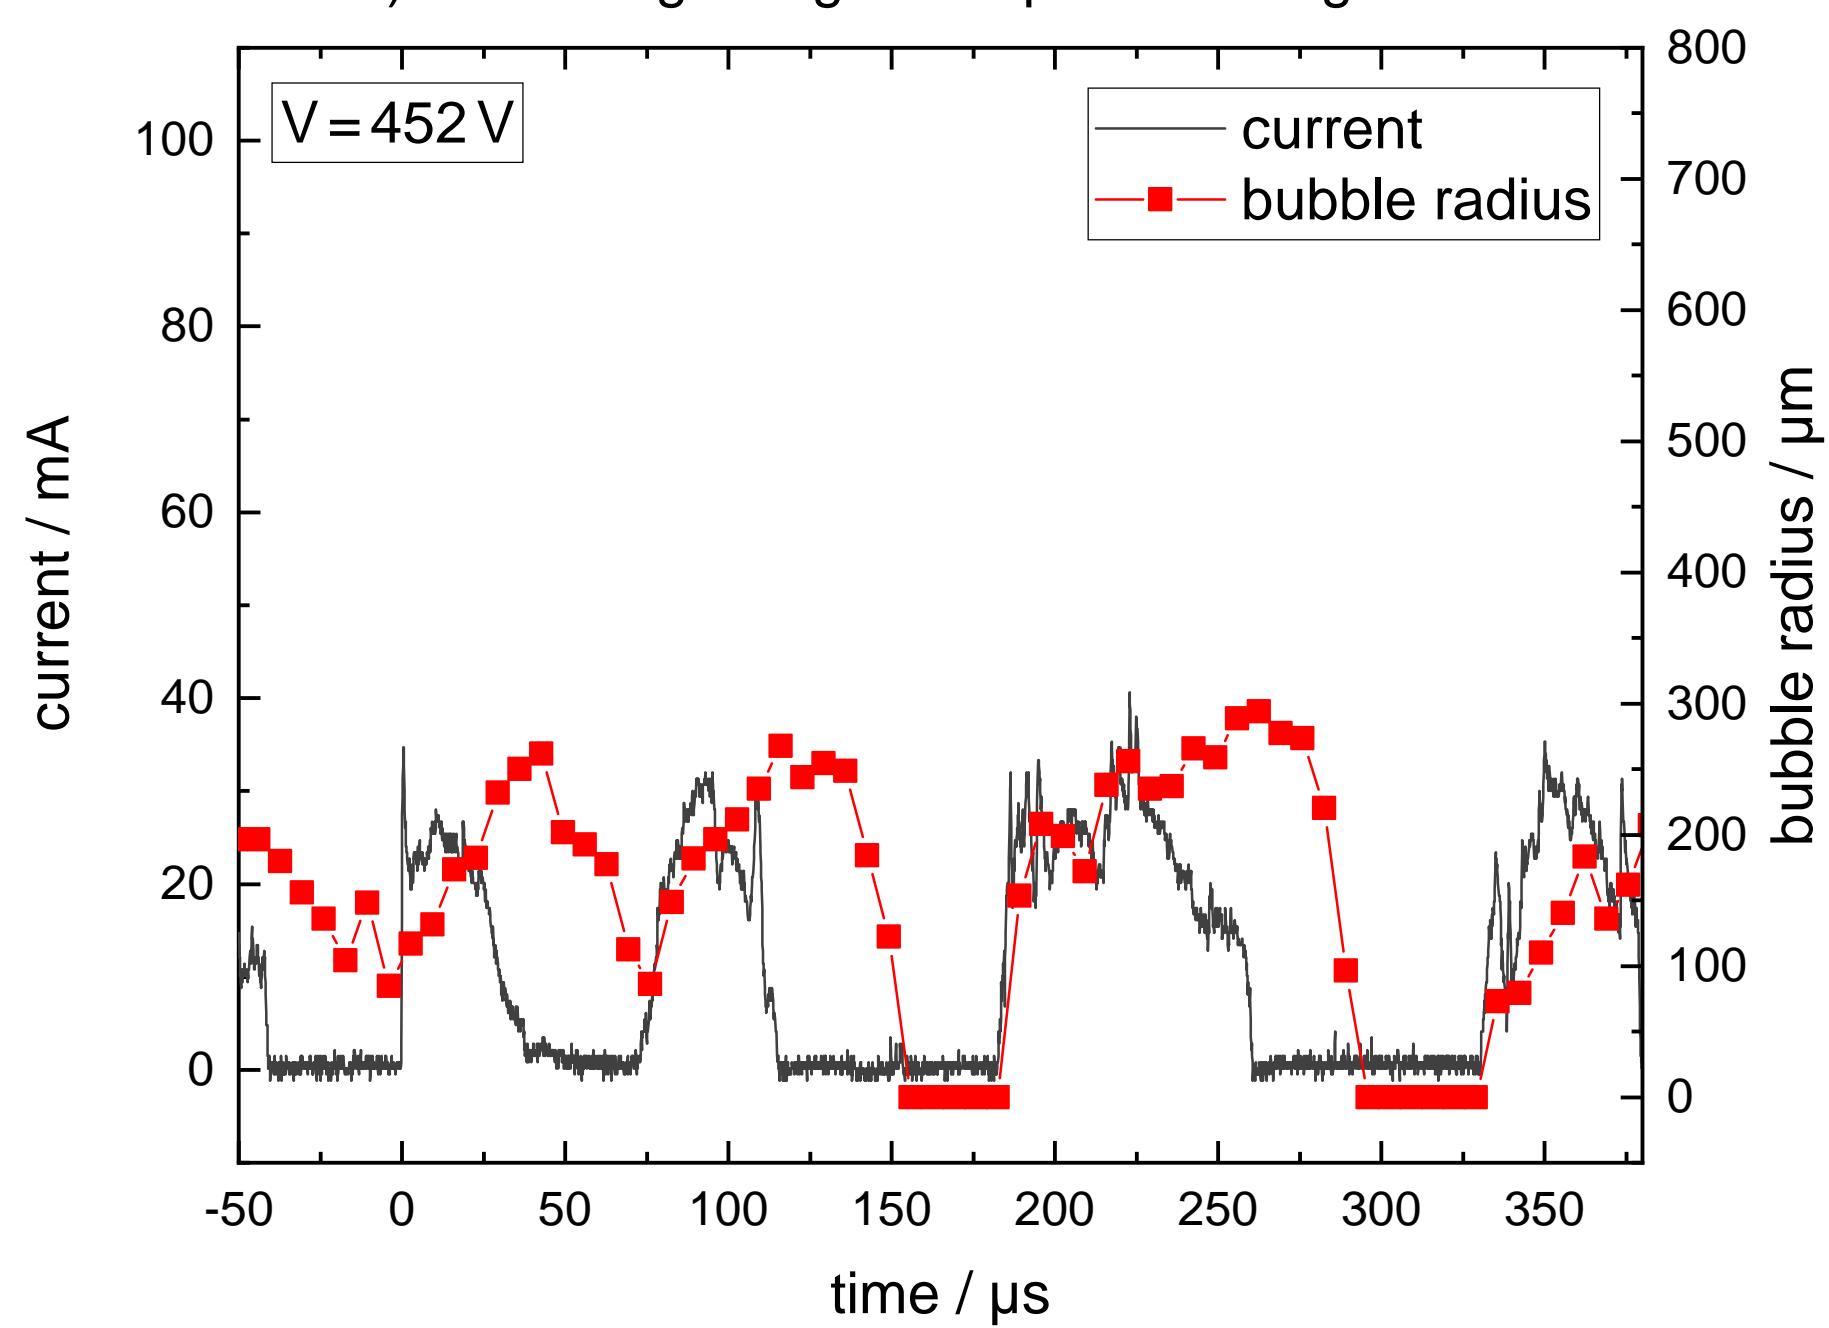

d) After 10 min treatment time - 3 g/l KOH

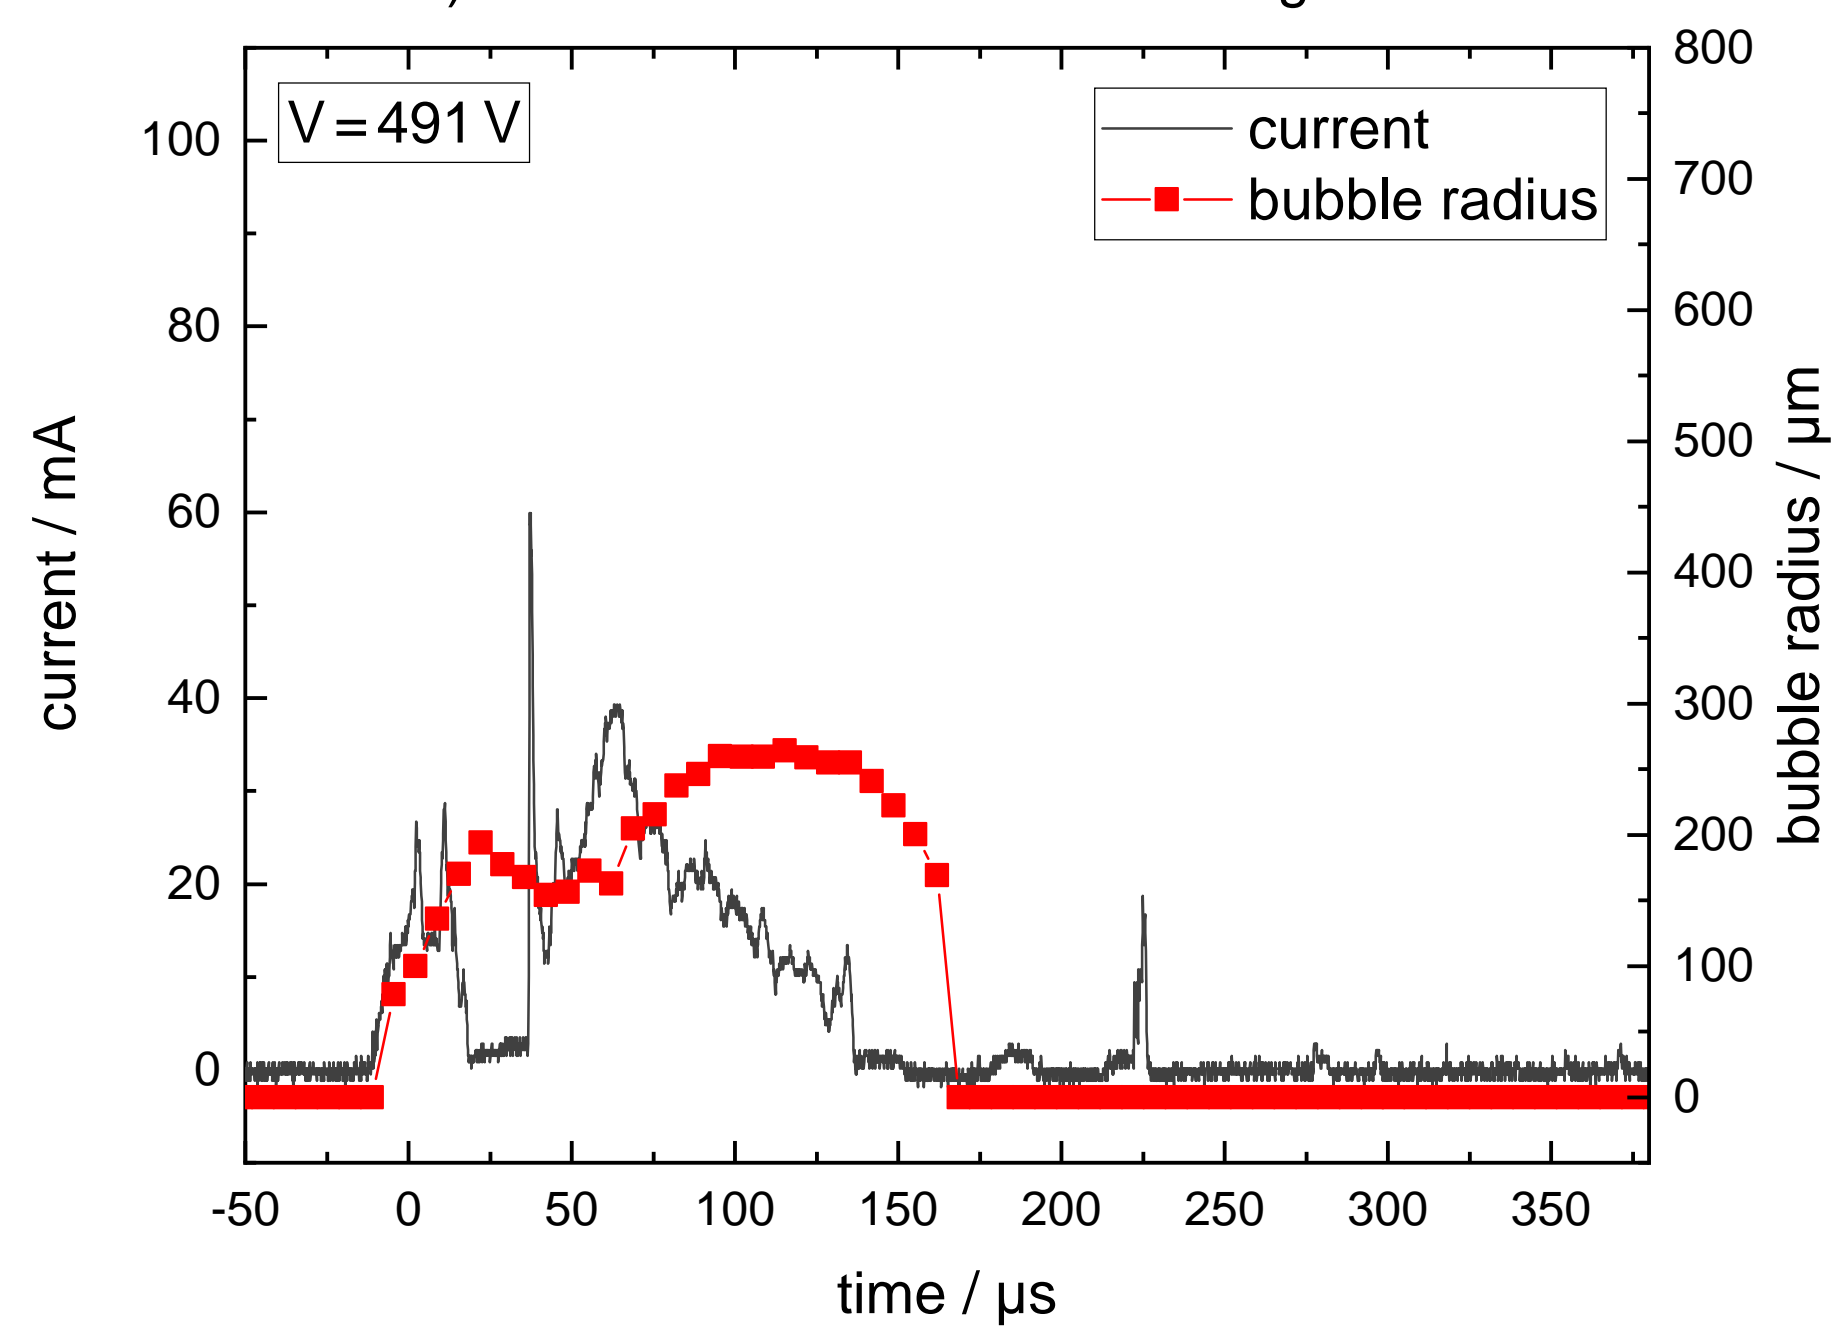

e) At the beginning of the process - 4 g/l KOH

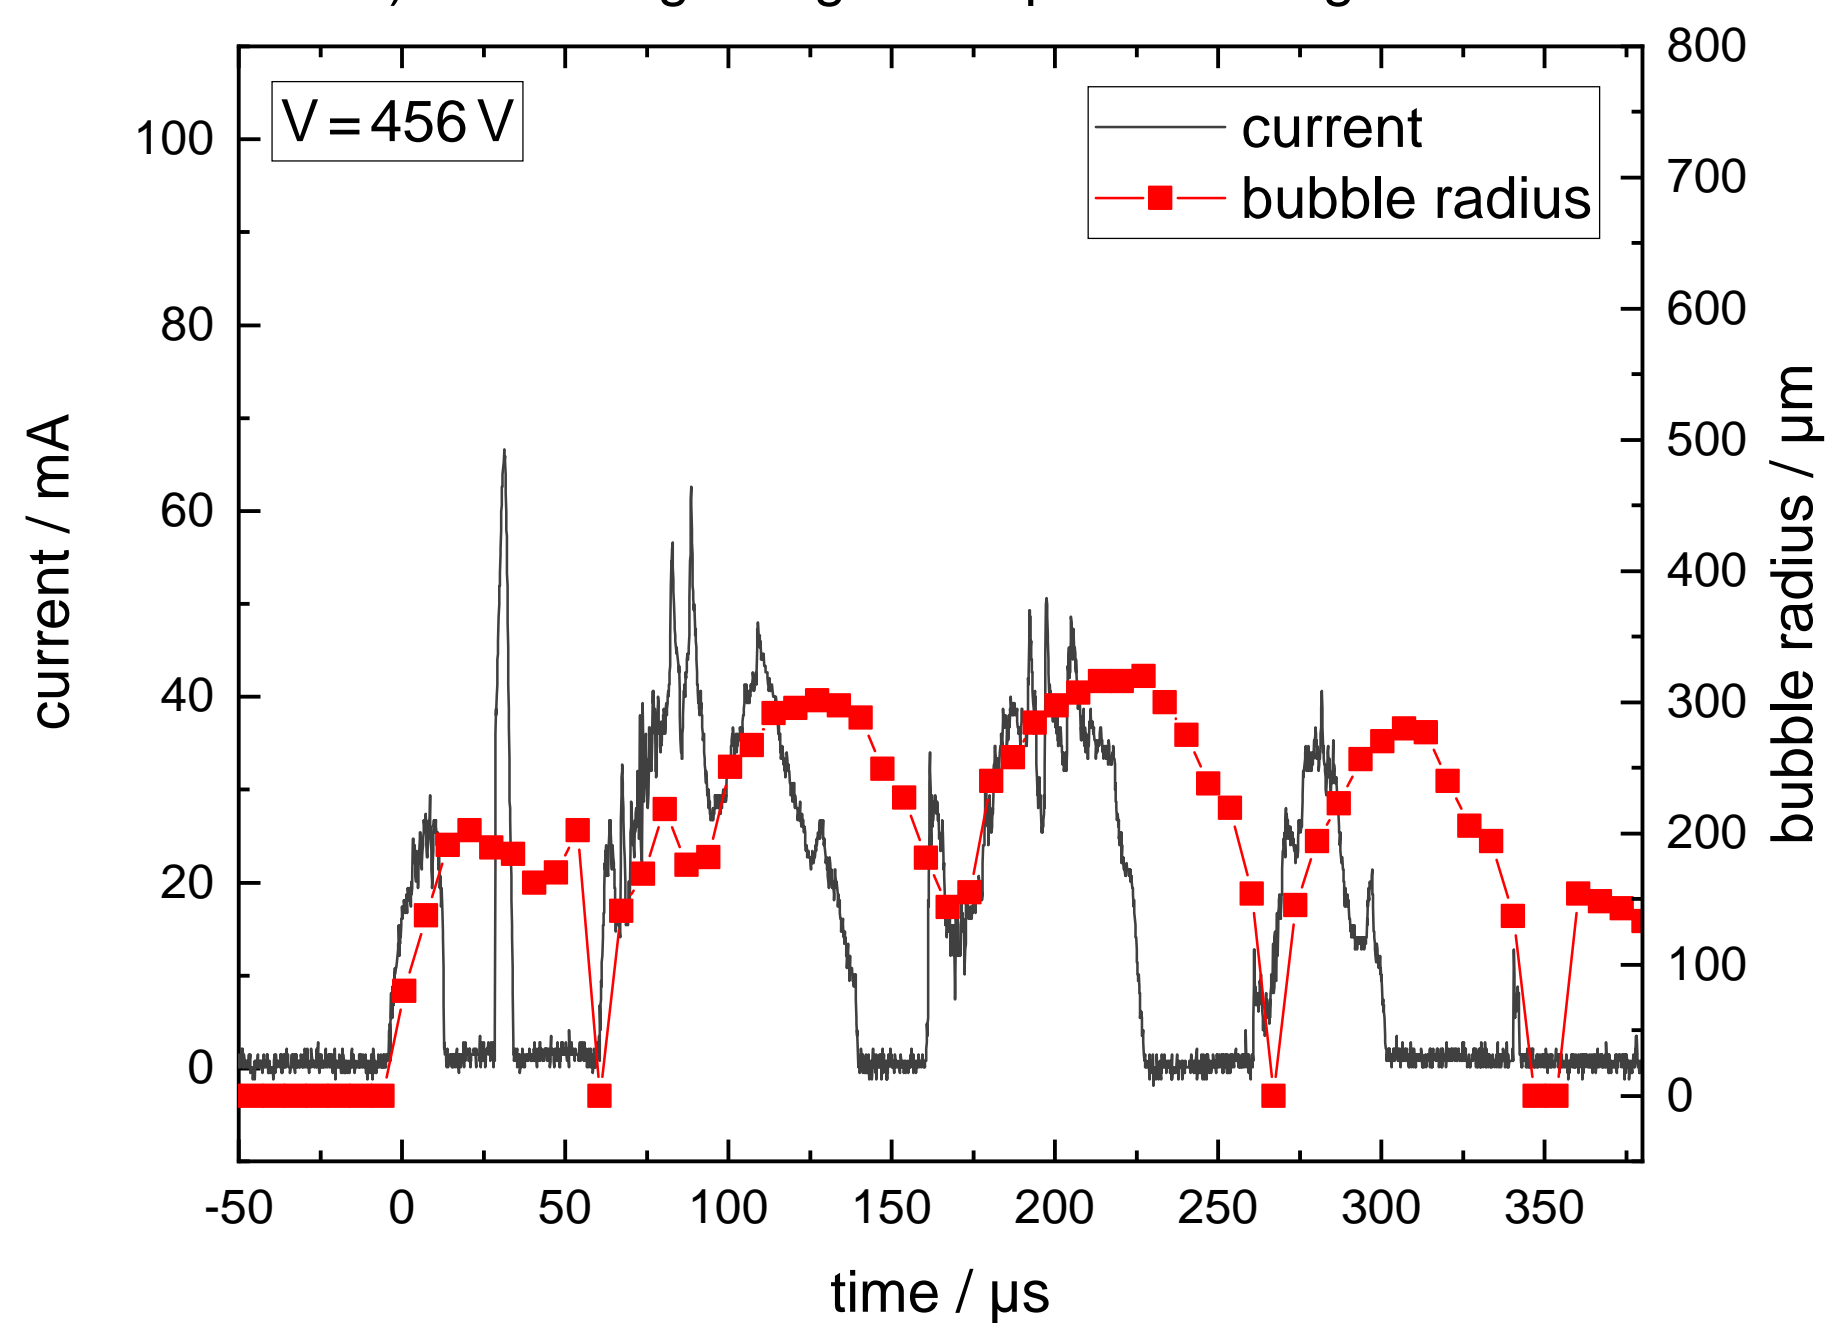

f) After 6 min treatment time - 4 g/l KOH

